


Standard for naming the signals in RS422/485 interfaces

Sidst revideret : 22.2.2016 - PN og BVJ

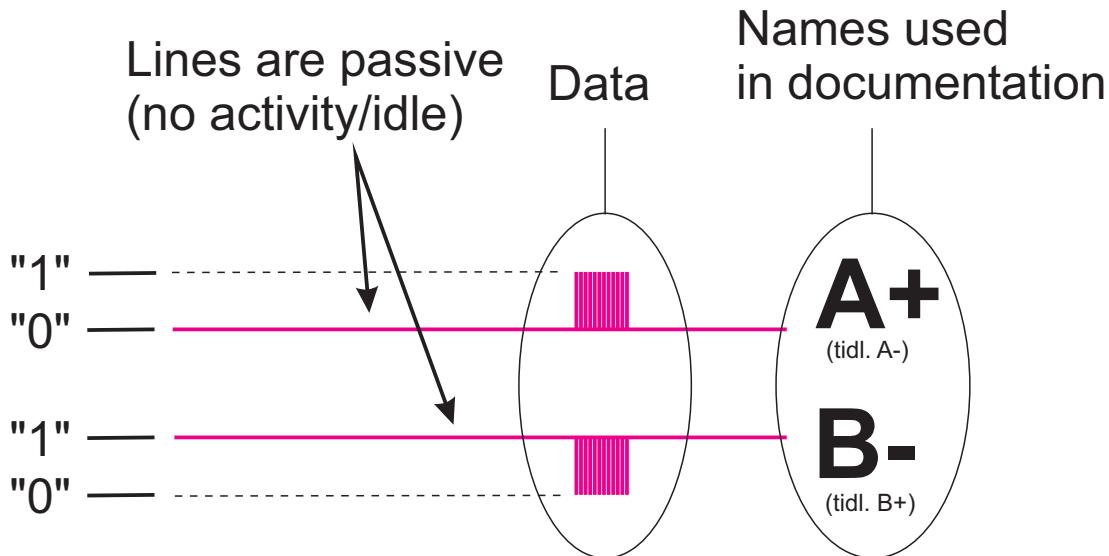

If more than one channel exist at the actual product the individual channels may be named as follows:

Channel 0 : **A0+** and **B0-**

Channel 1 : **A1+** and **B1-**

etc.

If a text description is attached to the terminal name the following should be used:

A+ : Positive data signal

B- : Negative data signal